

3

5

3%

3%

98%

5%

75% 85%  
70%  
6  
90%


2

/

OPT

50%

9

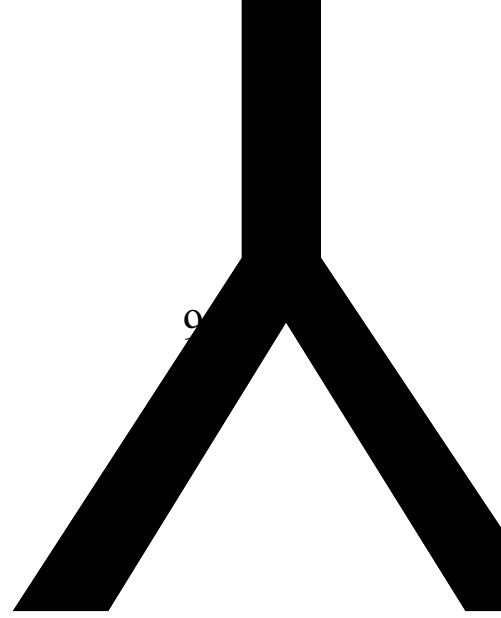

1

1

1

ý Ñ

8v u 1

2

MD

3  
80%  
5 64G  
10 CI FINDER  
10% 1%  
1%

2

IP 5G /  
3  
DD S

0

2

2

0-da

APT

90%

10

2

3

30%

30%

DNSSEC DNS

D H D T

DNS

10

DNS

1

3 5

1

10

10

3 5

500

5

1

500MB

10TB



10

1000

8

1PB

2

1

10

TB

60%

TB

200

80%

100

1

3

100

90%

100

1000PF1

80%

IP

20%

20%

2 3

IP

300  
2000  
95% 90%

OPC UA Modbus -RTU/TCP Siemens  
S7 Ethernet/IP IEC104 IEC 61850 DeltaV PKS CS3000  
MQTT 50

70%                      5  
                                 20                      80%

1

1 /

100 /

500

2

10

APT

0-da

5

B5G/6G

B5G/6G

B5G/6G

B5G/6G

B5G/6G

B5G/6G

2

100Gb

100Gb

20

10

B5G/6G

1

2

10

SL1

/

/

4

/

200m

1


/

3



SM2/3/4

	95%	10
		2
10		2

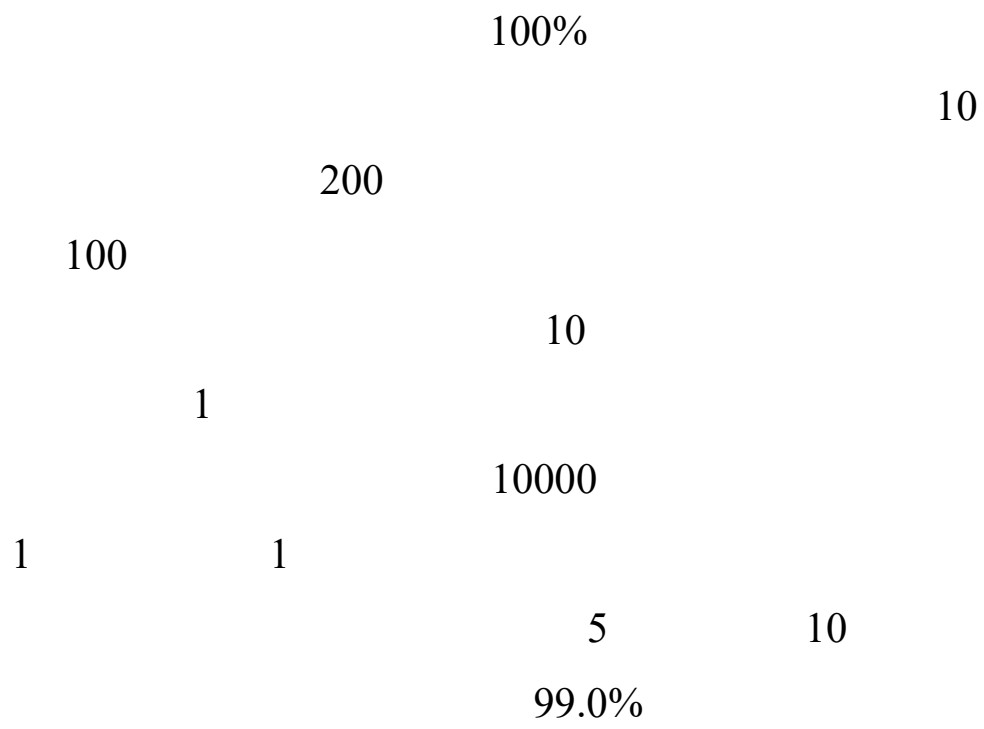

# ADS-B

5

2 3


5

95%

2

1

1

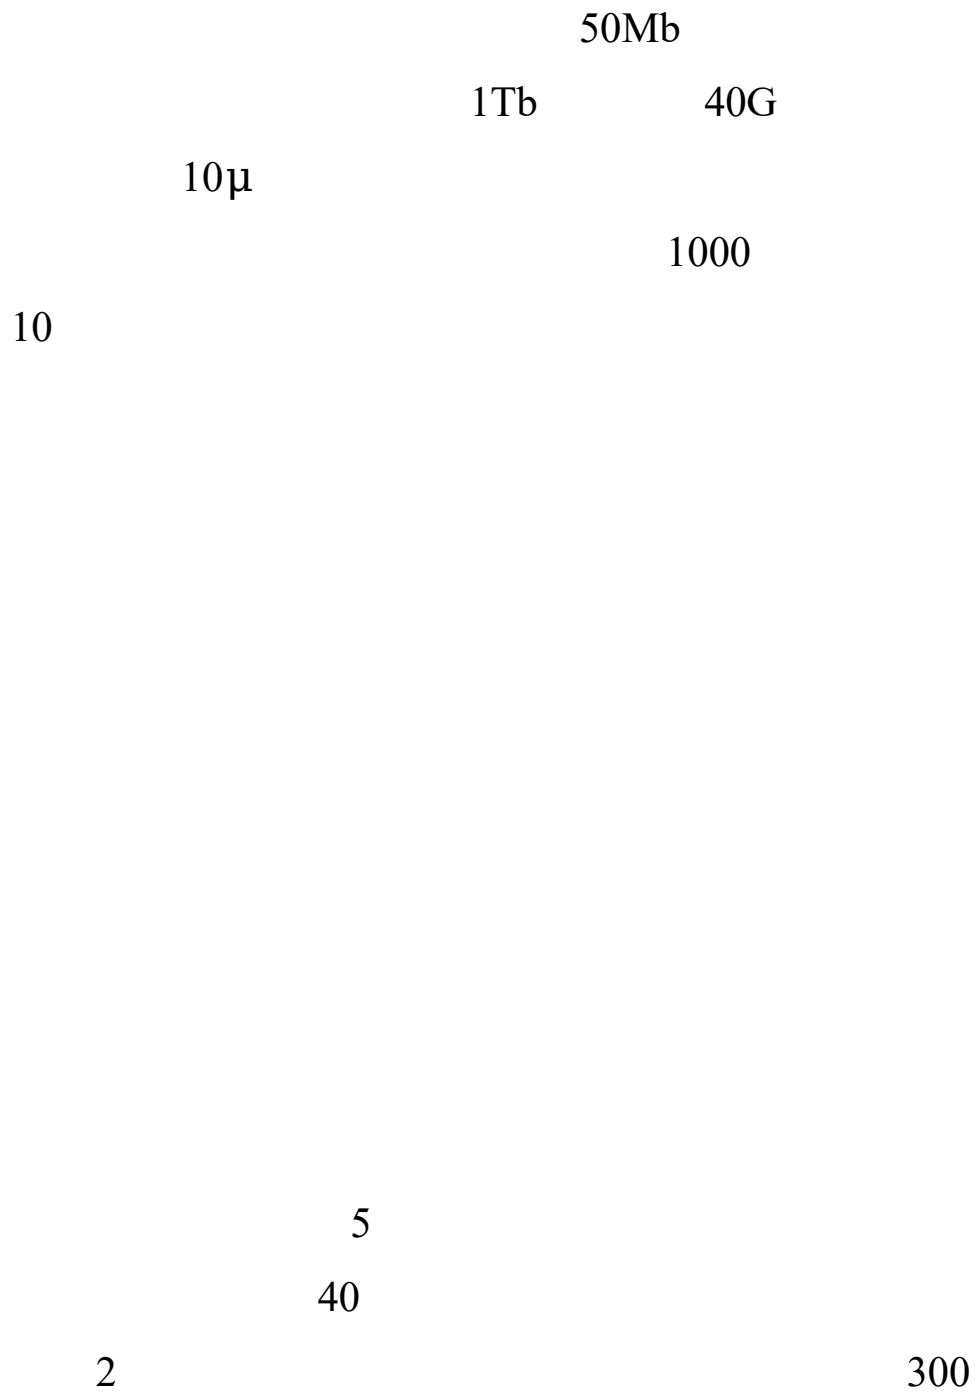

10

30%

80%